


Specification Sheet



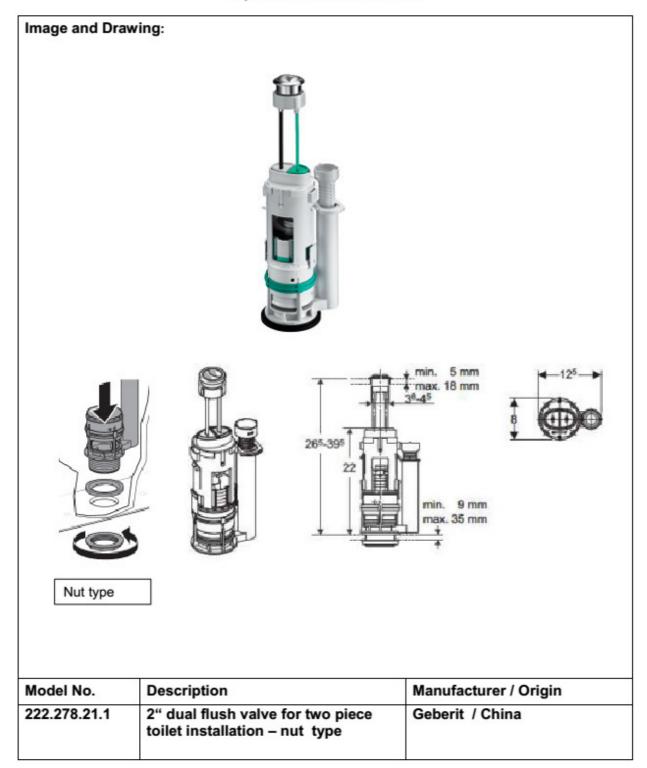

水務署

Water Supplies Department

香港灣仔告土打道七號人境事務大樓 Immigration Tower, 7 Gloucester Road, Hong Kong

電子郵遞 e-mail

wsdinfo@wsd.gov.hk

電 話 Telephone

2829 4367

圖文傳真 Facsimile

2824 0578

檔 號 Reference

(2) in WSD 3321/15 Pt.1 T/J(506)

19 November 2015

Geberit South East Asia Private Limited 1/F, 313 Lockhart Road, Wan Chai, Hong Kong

(Attn.: Mr Desmond LAU)

Dear Sir,

Approval of "GEBERIT" Flush Valves

Your letter dated 30 October 2015 refers.

Having considered test report ref. J18898 issued on 29 October 2015 by the Nutek Systems, Ltd., this Authority accepts that the fittings described below comply with, and their use when correctly installed does not contravene, the Waterworks Ordinance and Regulations.

Name of Manufacturer:

Geberit

Country of Origin:

China

Brand:

Geberit

Details of Fittings:

1. 2" Dual flush valve (Hook type for one piece toilet

installation)

Model: 222.277.21.1

2. 2" Dual flush valve (Nut type for two piece toilet

installation) Model: 222.278.21.1

Body Markings:

Logo of "Geberit" on body

Expiry Date:

27 July 2020

Proviso:

As the fittings have not been tested for use in contact with water intended for human consumption, the fitting can only be used in flushing water plumbing system.

This Authority hereby permits the use of the above fittings in flushing water plumbing systems subject to full adherence to Waterworks installation requirements. In particular, you are required to draw your customers' attention to the following requirement-

"The flushing volume of the flushing valves should be adjusted to suit the design of the toilet bowl so that wastes can be cleared effectively by a single flush."

"The maximum flushing cistern volume including that of dual flush cisterns for use in conjunction with the fittings shall not exceed 7.5 litres per flush."

"The fitting should be used within the range of working pressures specified by the manufacturer." AND

"As the water outlet of the fitting is immersed in water in actual use, no backflow of water will occur to contaminate the flushing water supply."

A condition of this acceptance is that the fittings to be installed shall be replicas of the samples as certified by the testing agent mentioned above and without modifications. This acceptance may be withdrawn at any time if the standard of the fittings installed fails to meet that of the approved samples or if the fittings are found to be unsuitable for use in flushing water plumbing systems.

For the use of the fittings in any project, the Acceptance Reference Number at the bottom of this letter must be quoted as a means of identification of acceptance of the fittings by this Authority.

Should you have any enquiries, please contact our Engineer Ms. K L FOK at tel. no. 2829 5657.

Yours faithfully,

(LAM Ching Man) for Water Authority c.c. WSD 3321/1/82] - without catalogue E/CS(TS)1]

Acceptance Reference No. C20150134F